




**WALL LEGEND**


-  (E) 2x8 STUD WALL
-  (E) 2x6 STUD WALL
-  (E) 2x4 STUD WALL

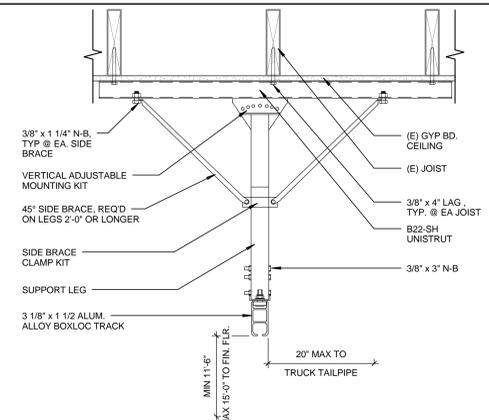

**2 TRACK MOUNTING - FRONT VIEW**  
1 1/2" = 1'-0"

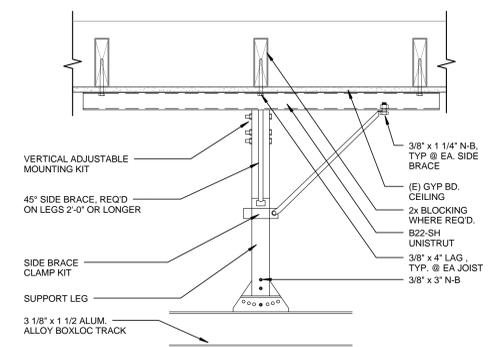



**3 TRACK MOUNTING - SIDE VIEW**  
1 1/2" = 1'-0"

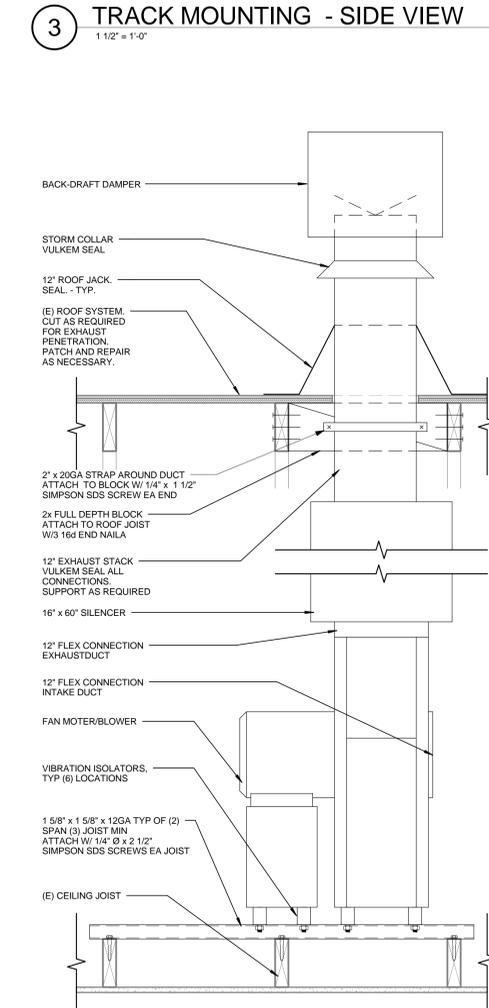

**4 FAN MOUNTING @ JOIST**  
1 1/2" = 1'-0"

**ELECTRICAL GENERAL NOTES**

PROVIDE NEW 35 AMP, 2 POLE CIRCUIT BREAKER THAT MATCHES EXISTING ELECTRICAL PANEL. SCCR RATING AT EXISTING ELECTRICAL PANEL. UPDATE PANEL SCHEDULE WITHIN EXISTING ELECTRICAL PANEL WITH NEW CIRCUIT. ROUTE NEW 1/2" EMT CONDUIT WITH 2#8 AWG. THWN CU AND 1#10 AWG. CU GND FROM EXISTING ELECTRICAL PANEL TO NEW EXHAUST FAN CONTROL PANEL. ROUTE NEW 1/2" EMT CONDUIT WITH 2#8 AWG. THWN CU AND 1#10 AWG. CU GND FROM NEW EXHAUST FAN CONTROL PANEL TO NEW EXHAUST FAN MOTOR RATED DISCONNECT. PROVIDE NEW 60 AMP MOTOR RATED DISCONNECT AT NEW EXHAUST FAN. PROVIDE FLEX CONNECTION FROM NEW MOTOR RATED DISCONNECT SWITCH TO NEW EXHAUST FAN MOTOR. ROUTE 1/2" EMT CONDUIT FROM NEW EXHAUST FAN CONTROL PANEL TO BAY JOIST TO ENCASE LOW VOLTAGE WIRING 2#10 THHN TO PRESSURE SENSORS. TYPICAL OF ALL PRESSURE SWITCHES. CONTRACTOR SHALL VERIFY QUANTITY OF PRESSURE SENSORS PRIOR TO BID. ELECTRICAL CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO BID. ELECTRICAL CONTRACTOR SHALL VERIFY EXACT LOCATION AND REQUIREMENTS WITH EXHAUST FAN MANUFACTURER AND CITY OF TURLOCK PRIOR TO ROUGH-IN FOR A COMPLETE AND OPERABLE SYSTEM.

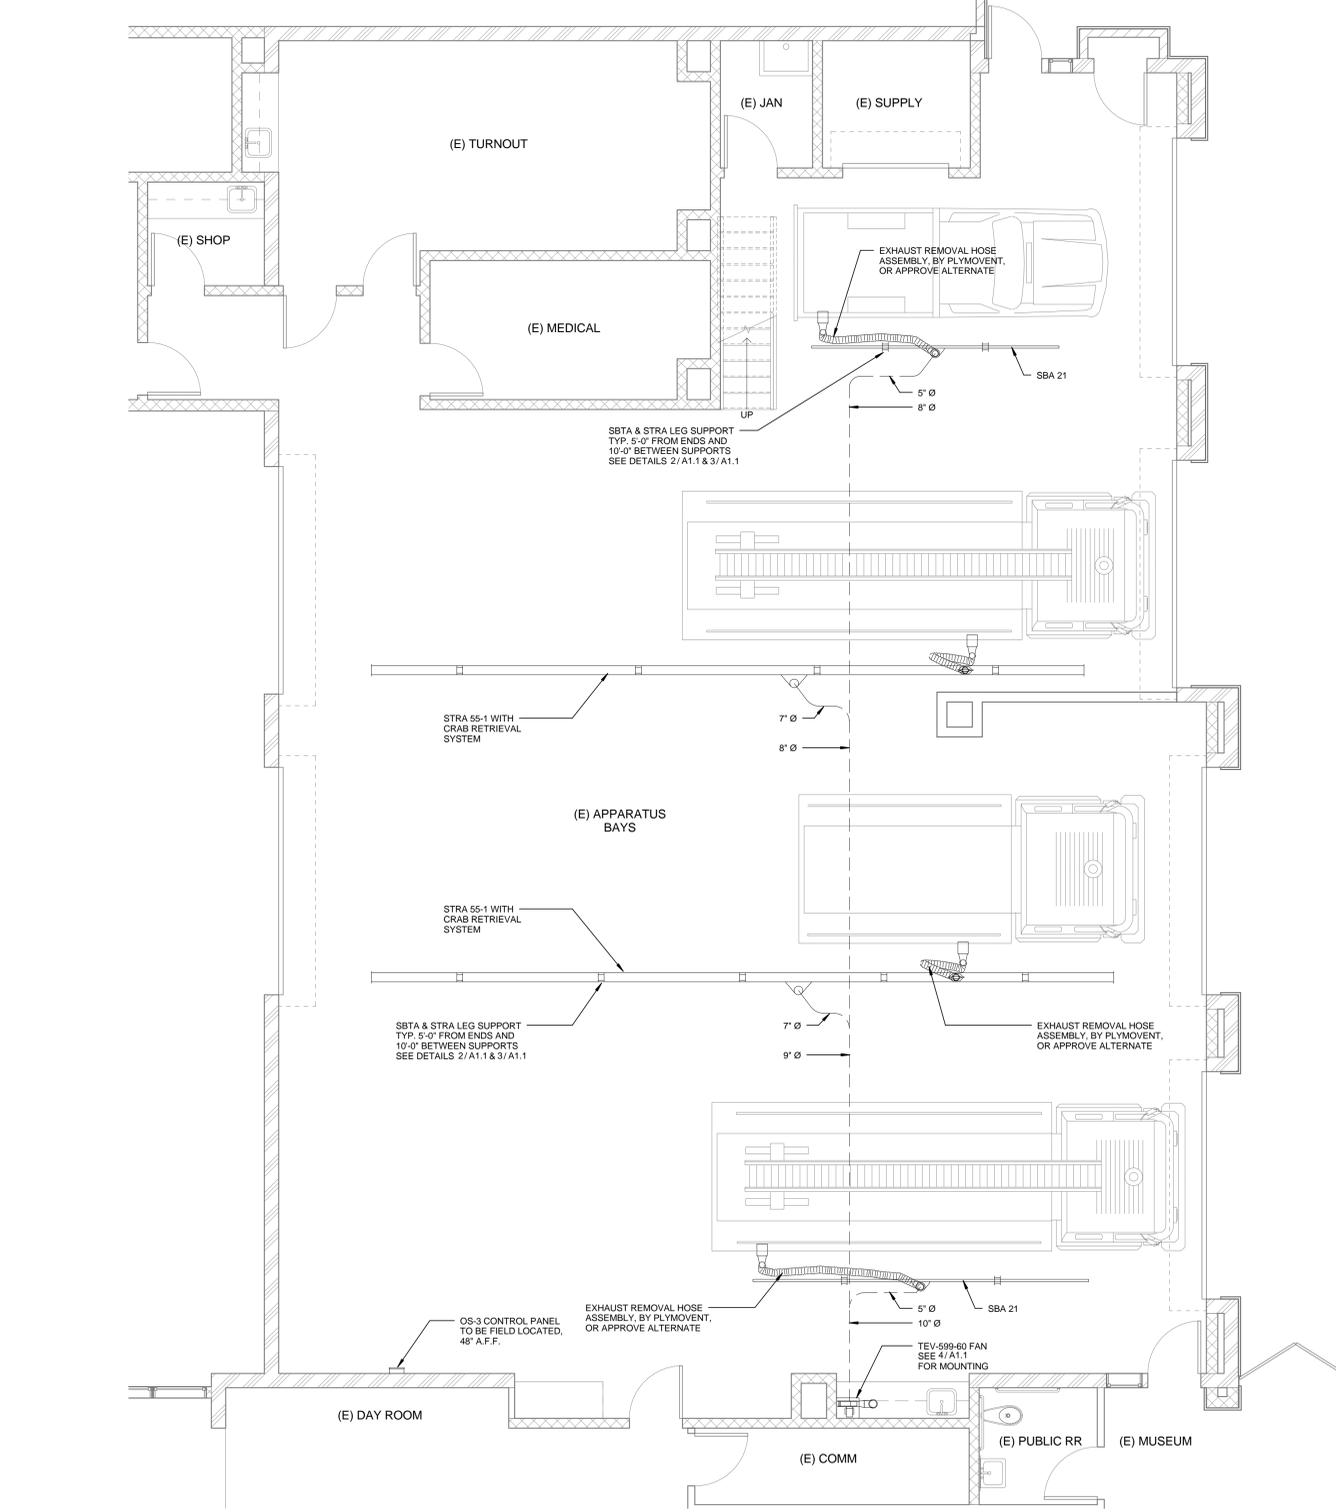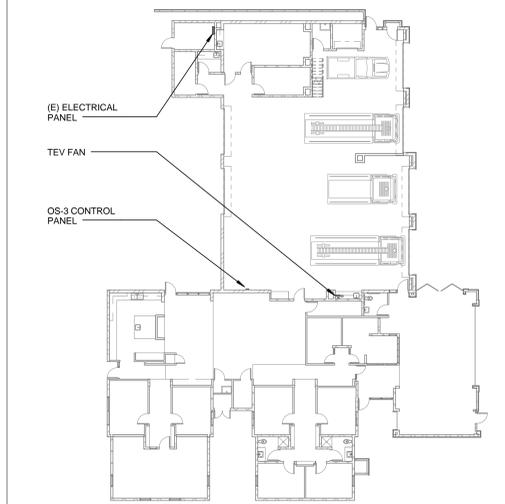


**1 PARTIAL FLOOR PLAN**  
1/4" = 1'-0"


P:\2016\16026 City of Turlock Fire Station Plymovent Equip. Install\16026.1 Station 1\Mech\16026.1 Turlock Fire Station 1.rvt

9/3/2016 10:31:51 AM




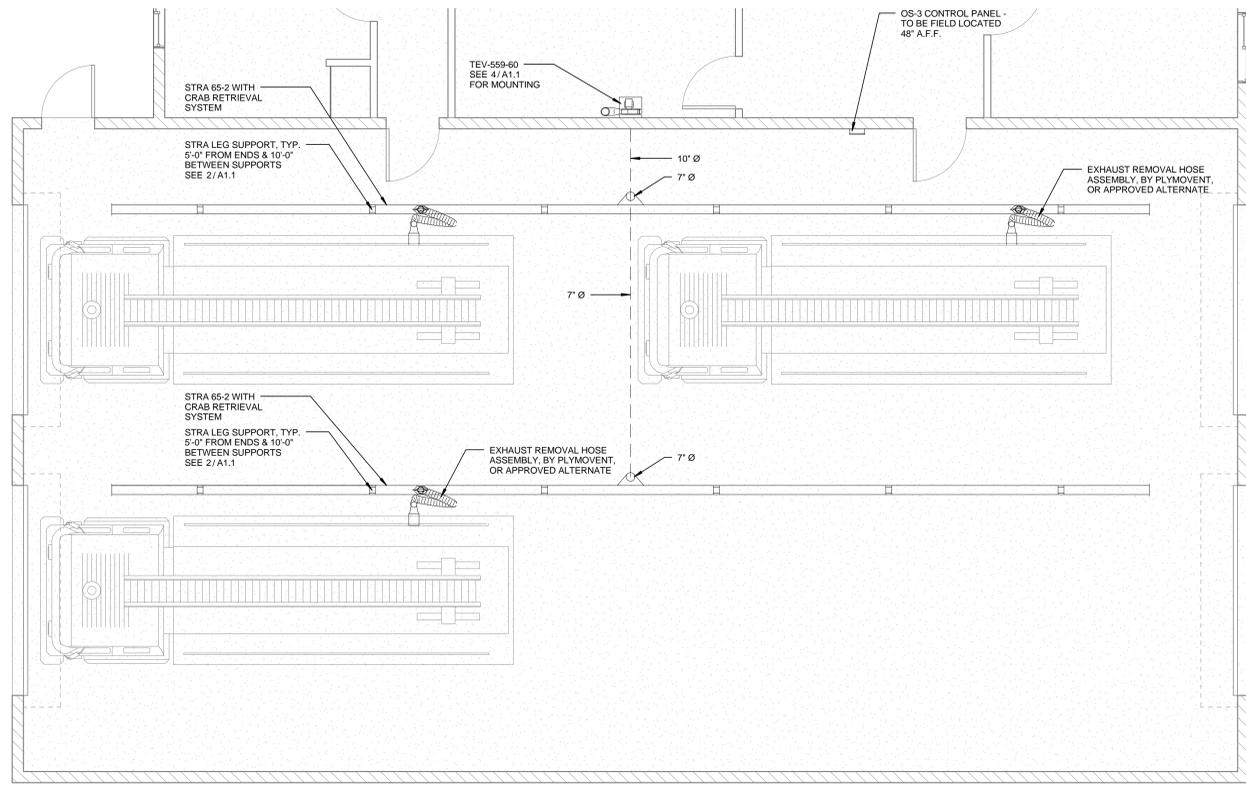


1 PARTIAL FLOOR PLAN  
1/4" = 1'-0"

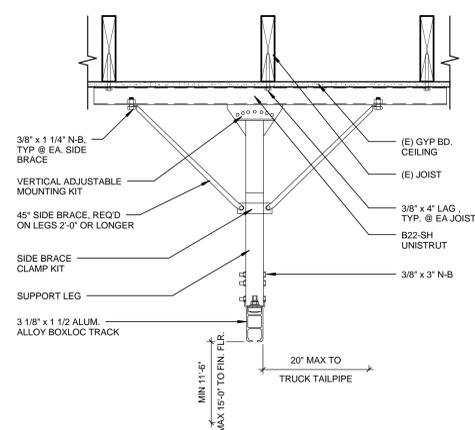

2 TRACK MOUNTING - FRONT VIEW  
1 1/2" = 1'-0"

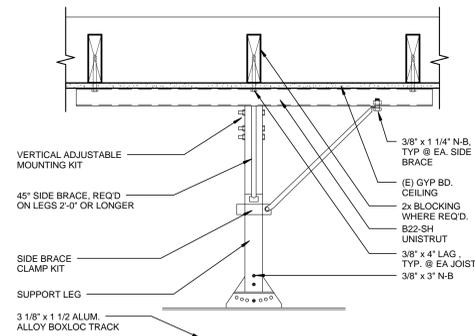

3 TRACK MOUNTING - SIDE VIEW  
1 1/2" = 1'-0"

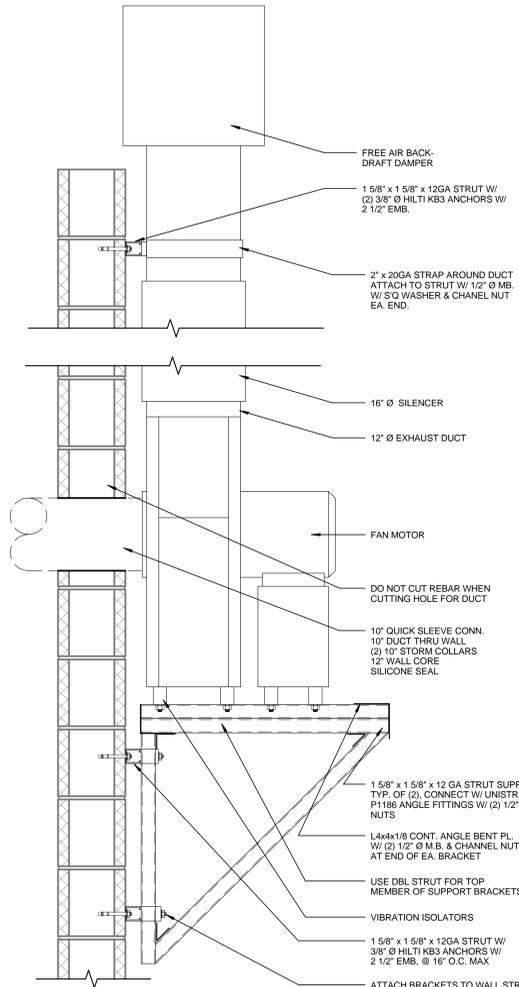


4 WALL MOUNT FAN  
1 1/2" = 1'-0"

WALL LEGEND



ELECTRICAL GENERAL NOTES

PROVIDE NEW 35 AMP, 2 POLE CIRCUIT BREAKER THAT MATCHES EXISTING ELECTRICAL PANEL SCOR RATING AT EXISTING ELECTRICAL PANEL. UPDATE PANEL SCHEDULE WITHIN EXISTING ELECTRICAL PANEL WITH NEW CIRCUIT. ROUTE NEW 3/4\"/>

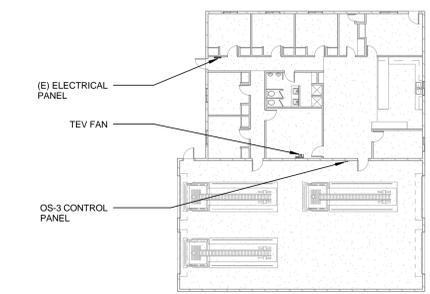

PROJECT REVISIONS


MARK	DATE	DESCRIPTION

# CITY OF TURLOCK FIRE STATION PLYMOVENT EQUIPMENT INSTALL

## CITY OF TURLOCK FIRE DEPARTMENT FIRE STATION NO. 2 791 S. WALNUT RD, TURLOK, CA 95380

PROJECT STATUS: CONSTRUCTION DOCUMENTS

ISSUE DATE: 04-20-2016



AN ARCHITECTURAL CORPORATION  
1720 G Street  
Modesto, CA 95354  
209.522.8900  
www.plnarchitects.com





CONSULTING ENGINEER

ARCHITECTURAL SYMBOLS LEGEND	ABBREVIATIONS	VICINITY MAP	PROJECT DIRECTORY	SHEET INDEX																																	
<p><b>DETAIL INDICATOR - REFERENCE &amp; DETAIL INDICATOR - SECTION</b></p> <p><b>DETAIL INDICATOR - ITEM &amp; DETAIL INDICATOR - AREA</b></p> <p><b>SECTION INDICATOR - PARTIAL BUILDING WALL</b></p> <p><b>SECTION INDICATOR - BUILDING</b></p> <p><b>ELEVATION INDICATOR - EXTERIOR</b></p> <p><b>ELEVATION INDICATOR - INTERIOR, SINGLE &amp; MULTIPLE VIEW</b></p> <p><b>MATCH LINE</b> SEE XX / X-XXX</p> <p><b>ROOM NAME</b> 101</p> <p><b>REVISION INDICATOR &amp; REVISION CLOUD</b></p> <p><b>ELEVATION INDICATOR - LEVEL &amp; SPOT</b></p> <p><b>REFERENCE GRID WITH REFERENCE GRID LINES</b></p> <p><b>WINDOW OR LOUVER IDENTIFIER</b></p> <p><b>DEMO KEYNOTE INDICATOR</b></p> <p><b>KEYNOTE INDICATOR</b></p> <p><b>FURNITURE, FIXTURE &amp; EQUIPMENT INDICATOR</b></p> <p><b>DOOR TAG IDENTIFIER</b></p> <p><b>PLAN NORTH &amp; TRUE NORTH INDICATOR</b></p>	<p><b>AC</b> ASPHALTIC CONCRETE <b>ACC</b> ACCESSIBLE <b>AGG</b> AGGREGATE <b>A/C</b> AIR CONDITIONER <b>AL</b> ALUMINUM <b>AB</b> ANCHOR BOLT <b>@</b> AT <b>ABV</b> ABOVE <b>AFF</b> ABOVE FINISH FLOOR <b>BLK</b> BLOCK <b>BLKG</b> BLOCKING <b>BD</b> BOARD <b>CB</b> CATCH BASIN <b>CF</b> CONTRACTOR <b>CFI</b> CONTRACTOR FURNISHED &amp; INSTALLED <b>CG</b> CORNER GUARD <b>CLG</b> CEILING <b>COL</b> COLUMN <b>CONC</b> CONCRETE <b>CMU</b> CONCRETE MASONRY UNIT <b>CONT</b> CONTINUOUS OR CONTINUE <b>DIAG</b> DIAGONAL <b>DS</b> DOWN SPOUT <b>DWGS</b> DRAWINGS <b>*</b> DIAMETER <b>ELECT</b> ELECTRICAL <b>ELEV</b> ELEVATION <b>EQ</b> EQUAL <b>(E)</b> EXISTING <b>EXH</b> EXHAUST <b>EXT</b> EXTERIOR <b>FOS</b> FACE OF STUD FLURR FLUORESCENT <b>FIN</b> FINISH <b>FLR</b> FLOOR <b>FD</b> FLOOR DRAIN <b>FTG</b> FOOTING <b>FND</b> FOUNDATION <b>GA</b> GAUGE <b>GALV</b> GALVANIZED <b>GL</b> GLASS OR GLAZING <b>GYP BD</b> GYPSUM BOARD <b>HDR</b> HEADER <b>HVAC</b> HEATING/VENTILATION/AIR CONDITIONING <b>HT</b> HEIGHT <b>HORIZ</b> HORIZONTAL <b>HB</b> HOSE BIB <b>INT</b> INTERIOR <b>JT</b> JOINT <b>LB</b> LAG BOLT <b>LAV</b> LAVATORY <b>LT</b> LIGHT <b>MAX</b> MAXIMUM <b>MECH</b> MECHANICAL <b>MTL</b> METAL <b>MIN</b> MINIMUM <b>NOT IN CONTRACT</b> <b>NTS</b> NOT TO SCALE <b>OBS</b> OBSOLETE <b>OC</b> ON CENTER <b>OFCI</b> OWNER FURNISHED CONTRACTOR INSTALLED <b>OFOI</b> OWNER FURNISHED OWNER INSTALLED <b>OR</b> OPERATION ROOM <b>OH</b> OVER HEAD <b>P/MT</b> PAVEMENT <b>PL</b> PLATE <b>PLN</b> PLAN <b>PLWD</b> PLYWOOD <b>RAD</b> RADIUS <b>RD</b> ROOF DRAIN <b>RM</b> ROOM <b>RR</b> RESTROOM <b>SCH</b> SCHEDULE <b>SHT</b> SHEET <b>SM</b> SIMILAR <b>SPEC</b> SPECIFICATION <b>SQ</b> SQUARE <b>STD</b> STANDARD <b>STOR</b> STORAGE <b>SAT</b> SUSPENDED <b>ACOUSTICAL TILE</b> <b>SYS</b> SYSTEM <b>TEL</b> TELEPHONE <b>THK</b> THICK <b>TAG</b> TONGUE &amp; GROOVE <b>T.O.P.</b> TOP OF PLATE (ELEV.) <b>TYP</b> TYPICAL <b>UN</b> UNLESS OTHERWISE NOTED <b>VCT</b> VINYL COMPOSITIONAL TILE <b>VB</b> VINYL BASE <b>V.I.F.</b> VARY IN FIELD <b>WC</b> WATER CLOSET <b>WP</b> WEATHER OR WATER PROOF <b>WD</b> WOOD</p> <p><b>DEMO NOTES</b></p> <p>- NONE</p>	<p><b>VICINITY MAP</b></p> <p><b>PROJECT SCOPE</b></p> <p>TO INSTALL NEW PLYMOVENT EXHAUST REMOVAL APPARATUS SYSTEM IN EXISTING BAYS.</p> <p><b>DEFERRED APPROVALS</b></p> <p>- NONE</p>	<p><b>PROJECT DIRECTORY</b></p> <p><b>ARCHITECT</b> PIRES, LIPOMI AND NAVARRO ARCHITECTS PRINCIPAL ARCHITECT: GREG PIRES 1720 G STREET MODESTO, CA 95354 P: 209.522.8900 GREG@PLNARCHITECTS.COM</p> <p><b>OWNER</b> CITY OF TURLOCK FIRE STATION #2 PRINCIPAL CIVIL ENGINEER: NATHAN BRAY, PE 156 S. BROADWAY, STE 150 TURLOCK, CA 95380 P: 209.668.5599 x4435</p> <p><b>SPECIALTY EQUIPMENT</b> AIR EXCHANGE SPECIALTY EQUIPMENT: DICK BERTANI 495 EDISON COURT, STE A FAIRFIELD, CA 94534 P: 800.500.2945 F: 707.864.2705 DICK@AIR EXCHANGE.COM</p> <p><b>PROJECT DATA</b></p> <p>SITE ADDRESS: TURLOCK FIRE STATION NO. 2 791 S. WALNUT RD. TURLOCK, CA 95380</p> <p>PROJECT AREA: 2525 SQ.FT. CONSTRUCTION: V-N OCCUPANCY TYPE: R-2 SPRINKLERED: YES NUMBER OF FLOORS: 1</p>	<p><b>SHEET INDEX</b></p> <p><b>GENERAL SHEETS</b> G0.0 COVER SHEET</p> <p><b>ARCHITECTURAL SHEETS</b> A1.1 FLOOR PLAN &amp; DETAILS</p> <p><b>AUTHORITY HAVING JURISDICTION</b></p> <p>SUBMITTAL #</p> <p><b>CITY OF TURLOCK FIRE STATION PLYMOVENT EQUIPMENT INSTALL</b> 791 S. WALNUT RD., TURLOK, CA 95380 CITY OF TURLOCK FIRE DEPARTMENT (Enter Client Address)</p> <p><b>PROJECT DETAILS</b> PLN PROJECT NO: 16026.2 SUBMITTAL DATE:</p> <p><b>PROJECT REVISIONS</b></p> <table border="1"> <thead> <tr> <th>MARK</th> <th>DATE</th> <th>DESCRIPTION</th> </tr> </thead> <tbody> <tr><td> </td><td> </td><td> </td></tr> </tbody> </table> <p><b>SHEET DETAILS</b> DRAWN BY: Author CHECKED BY: Checker COPYRIGHT: © PLN ARCHITECTS 2015</p> <p><b>SHEET TITLE</b> COVER SHEET</p> <p><b>SHEET NUMBER</b> G0.0</p>	MARK	DATE	DESCRIPTION																														
MARK	DATE	DESCRIPTION																																			
<p><b>GENERAL NOTES</b></p> <ol style="list-style-type: none"> <li>CODES: ALL WORK SHALL CONFORM TO THE FOLLOWING CODES. CONTRACTOR AND THEIR SUBCONTRACTORS SHALL HAVE WORKING KNOWLEDGE OF ALL CODES. REGULATIONS AND/OR STANDARDS APPLICABLE TO THEIR WORK. CONTRACTOR SHALL MAKE AVAILABLE LISTED CODES AT JOB SITE AT ALL TIMES. 2013 BUILDING ENERGY EFFICIENCY STANDARDS 2013 CALIFORNIA GREEN BUILDING STANDARDS 2013 CALIFORNIA ADMINISTRATIVE CODE (CAC) PART 1, TITLE 24, CALIFORNIA CODE OF REGULATIONS (CCR) 2013 CALIFORNIA BUILDING CODE (CBC) PART 2, TITLE 24, CCR BASED ON THE 2012 INTERNATIONAL BUILDING CODE (IBC) 2013 CALIFORNIA ELECTRICAL CODE (CEC) PART 3, TITLE 24, CCR BASED ON THE 2011 NATIONAL ELECTRICAL CODE (NEC) 2013 CALIFORNIA MECHANICAL CODE (CMC) PART 4, TITLE 24, CCR BASED ON THE 2011 UNIFORM MECHANICAL CODE (UMC) 2013 CALIFORNIA PLUMBING CODE (CPC) PART 5, TITLE 24, CCR BASED ON THE 2011 UNIFORM PLUMBING CODE (UPC) 2013 CALIFORNIA FIRE CODE (CFC) PART 9, TITLE 24, CCR BASED ON THE 2011 INTERNATIONAL FIRE CODE (IFC)</li> <li>EXISTING CONDITIONS: ALL EXISTING CONDITIONS NOT SHOWN OR INDICATED ON THESE PLANS ARE TO REMAIN UNCHANGED. FIELD VERIFY EXISTING CONDITIONS AND ALL DIMENSIONS. ANY DISCREPANCY BETWEEN DRAWINGS AND ACTUAL WORK SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT FOR CORRECTION PRIOR TO COMMENCING WITH THE WORK.</li> <li>INSULATION: ALL INSULATION MATERIALS, INCLUDING FACINGS, SUCH AS VAPOR BARRIERS OR BREATHER PAPERS INSTALLED WITHIN FLOOR-CEILING ASSEMBLIES, ROOF-CEILING ASSEMBLIES, WALLS, CRAWL SPACES OR ATTICS, SHALL HAVE A FLAME SPREAD RATING NOT TO EXCEED 25 AND A SMOKE DENSITY NOT TO EXCEED 450 WHEN TESTED IN ACCORDANCE WITH SECTION 903 IN THE 2013 CBC.</li> <li>WORK: ALL WORK SHALL BE DONE IN A NEAT AND WORKMAN LIKE MANNER ACCORDING TO THE BEST TRADE PRACTICE BY THOSE SKILLED IN THE PARTICULAR TRADE. EQUIPMENT, FIXTURES, PIPING, ETC., SHALL BE PLUMB, LEVEL, SQUARE OR CENTERED ETC. EQUIPMENT TO BE INSTALLED IN STRICT COMPLIANCE WITH MANUFACTURERS' RECOMMENDATIONS.</li> <li>ANCHORS: WHEN INSTALLING DRILLED-IN ANCHORS AND/OR POWDER DRIVEN PINS IN EXISTING NON-PRESTRESSED REINFORCED CONCRETE, USE CARE AND CAUTION TO AVOID CUTTING OR DAMAGING THE EXISTING REINFORCING BARS. WHEN INSTALLING THEM INTO EXISTING PRE STRESSED TENDONS, USE A NONDESTRUCTIVE METHOD PRIOR TO INSTALLATION. EXERCISE EXTREME CARE AND CAUTION TO AVOID CUTTING OR DAMAGING THE TENDONS.</li> <li>PLANS: GENERAL CONTRACTOR SHALL MAKE AVAILABLE COMPLETE SETS OF APPROVED CONSTRUCTION DOCUMENTS TO HIS OR HER SUBCONTRACTORS FOR REVIEW. EACH SUBCONTRACTOR SHALL BE RESPONSIBLE FOR REVIEWING THE COMPLETE SET AND COORDINATING ITEMS WHICH PERTAIN TO HIS OR HER WORK WITH OTHER TRADES PRIOR TO COMMENCING WITH THE WORK. MAKE SURE THE DRAWINGS YOU USE ARE APPROVED AND UP TO DATE.</li> <li>ACCESS: ALL VALVES, DETECTORS, FIRE AND SMOKE DAMPERS SHALL BE ACCESSIBLE, WHETHER OR NOT SHOWN ON PLANS AT EACH LOCATION.</li> <li>SCOPE OF WORK: IT IS NOT INTENDED THAT THE CONTRACT DOCUMENTS INCLUDE EACH AND EVERY SUBSYSTEM AND SUBCOMPONENT NECESSARY TO FULLY AND PROPERLY COMPLETE THE WORK. SUBSYSTEMS, SUBCOMPONENTS OR DETAILS REQUIRED OR NORMALLY INCLUDED AS TRADE PRACTICE MAY NOT BE SPECIFICALLY MENTIONED OR SHOWN. NEVERTHELESS, CONTRACTOR SHALL BE RESPONSIBLE FOR EACH ELEMENT OF THE WORK.</li> <li>FIRE EXTINGUISHERS: NECESSARY 2A:10BC OR BETTER PORTABLE FIRE EXTINGUISHERS ARE PER SECTION 906, PART 9 (CFC), TITLE 24, CAC AND TITLE 19, CCR. AT REMODELS, PROTECT AND PROVIDE ADEQUATE CLEARANCES AROUND EXISTING EXTINGUISHERS CONSTRUCTION AS NECESSARY. ADDITIONAL FIRE EXTINGUISHERS, BY CONTRACTOR, MAY BE NEEDED CONSTRUCTION. PERMANENT FACILITIES REQUIRE A MINIMUM OF ONE PORTABLE FIRE EXTINGUISHER IN APPLICABLE BUILDINGS. LIMIT TRAVEL DISTANCE TO 75 FEET. VERIFY LOCATION(S) WITH OWNER &amp; ALSO IF NOT ALREADY SHOWN ON PLANS. EXTINGUISHERS ARE REQUIRED IN ELEVATOR EQUIPMENT ROOMS. ACCESSIBLE PORTIONS SHALL NOT EXCEED 48" AFF. 20BC OR BETTER</li> <li>SPECIAL TESTING AND INSPECTION FOR EXPANSION ANCHORS, CONCRETE CEILING WIRES ETC. TO BE COORDINATED BY CONTRACTOR. TESTING LAB CONTRACTED BY OWNER. COST OF REINSPECTION TO BE PAID BY CONTRACTOR.</li> </ol>	<p><b>SITE PLAN</b></p>																																				


PROJECT REVISIONS

MARK	DATE	DESCRIPTION


WALL LEGEND

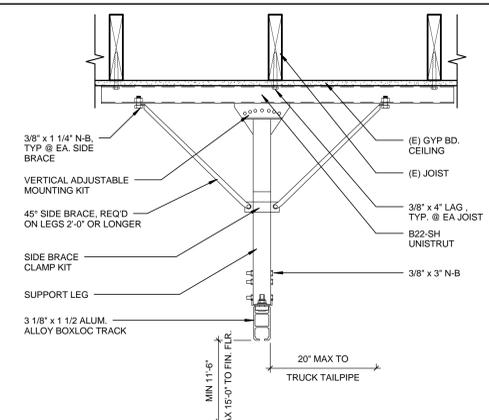

2 TRACK MOUNTING - FRONT VIEW  
1 1/2" = 1'-0"

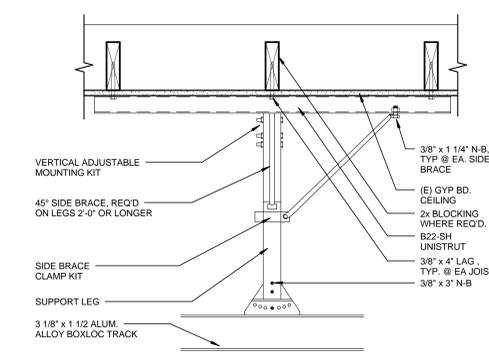



3 TRACK MOUNTING - SIDE VIEW  
1 1/2" = 1'-0"

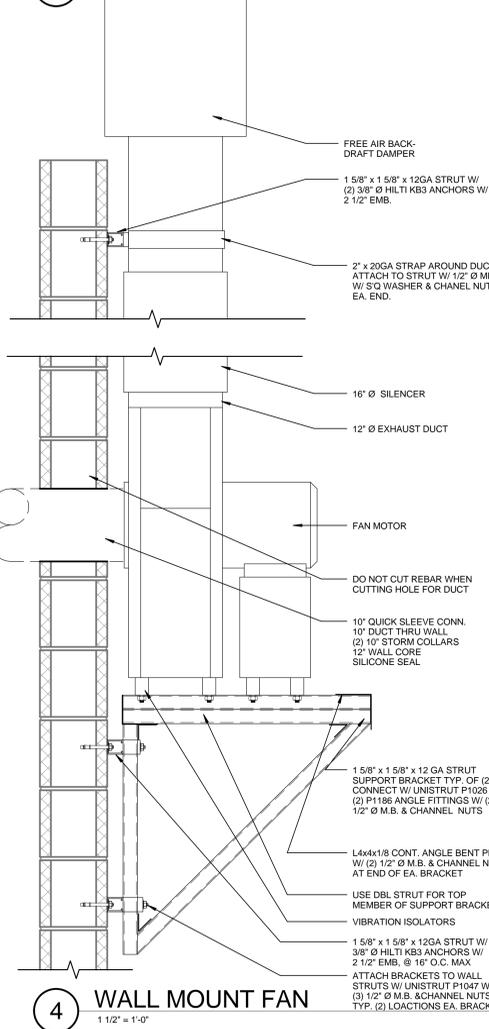

4 WALL MOUNT FAN  
1 1/2" = 1'-0"

ELECTRICAL GENERAL NOTES

PROVIDE NEW 20 AMP, 2 POLE CIRCUIT BREAKER THAT MATCHES EXISTING ELECTRICAL PANEL SCRR RATING AT EXISTING ELECTRICAL PANEL. REARRANGE EXISTING CIRCUIT BREAKERS WITHIN EXISTING ELECTRICAL PANEL TO PROVIDE AVAILABLE SPACE FOR NEW CIRCUIT BREAKER. UPDATE PANEL SCHEDULE WITHIN EXISTING ELECTRICAL PANEL WITH NEW CIRCUIT. ROUTE NEW 3/4\"/>

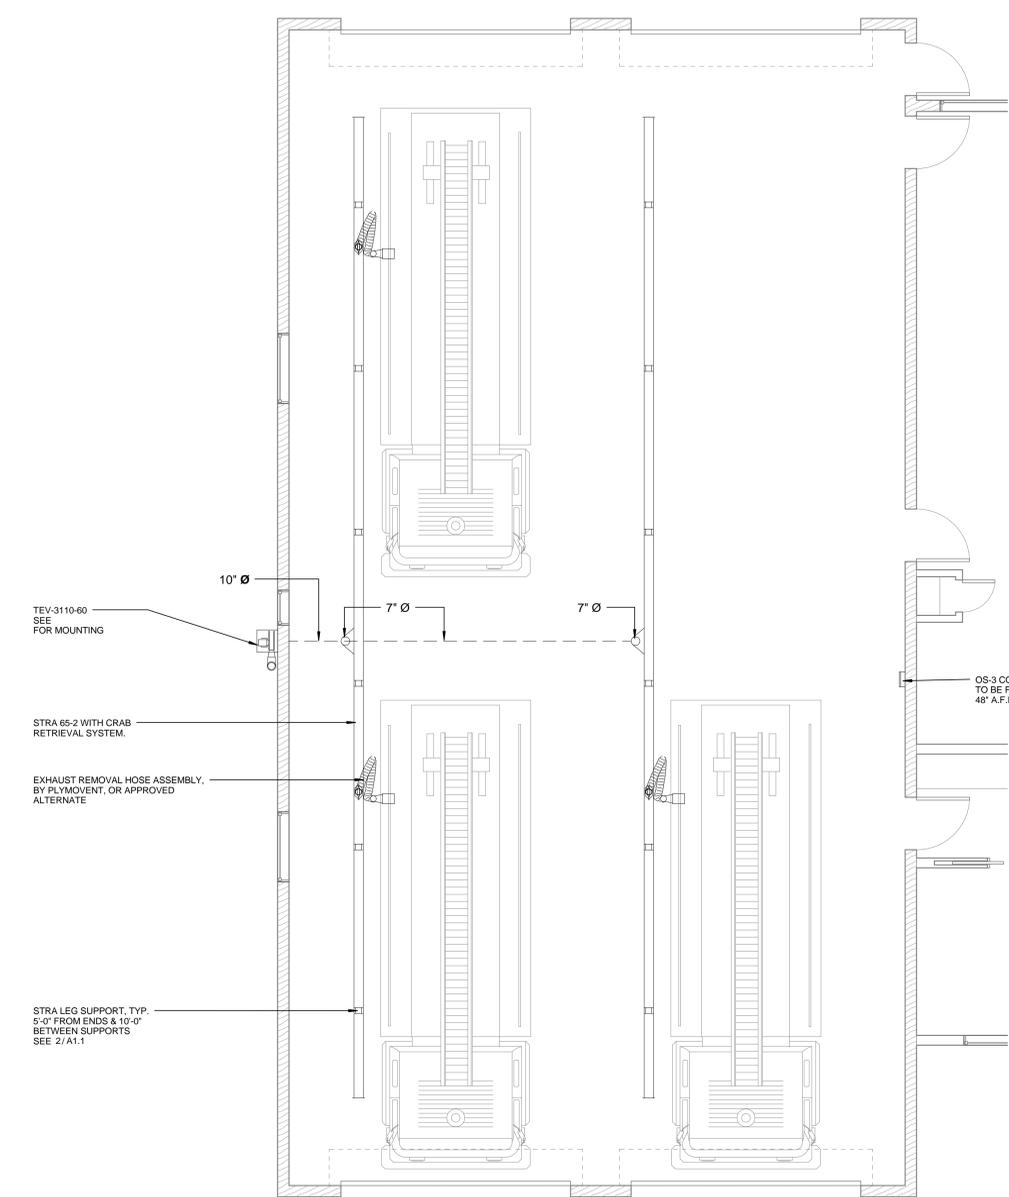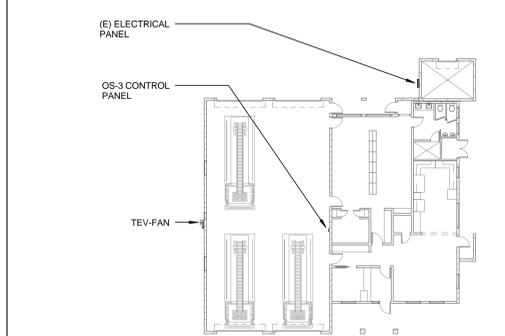

1 PARTIAL FLOOR PLAN  
1/4" = 1'-0"


TEV-3110-60 SEE FOR MOUNTING  
7' Ø  
7' Ø  
STRA 65-2 WITH CRAB RETRIEVAL SYSTEM.  
EXHAUST REMOVAL HOSE ASSEMBLY, BY PLYMOVENT, OR APPROVED ALTERNATE  
STRA LEG SUPPORT, TYP. 5'-0" FROM ENDS & 10'-0" BETWEEN SUPPORTS. SEE 2/A1.1  
OS-3 CONTROL PANEL - TO BE FIELD LOCATED 48" A.F.F.

# CITY OF TURLOCK FIRE STATION PLYMOVENT EQUIPMENT INSTALL

## CITY OF TURLOCK FIRE DEPARTMENT FIRE STATION NO. 3 501 E. MONTE VITA AVE, TURLOCK, CA 95380

PROJECT STATUS: CONSTRUCTION DOCUMENTS

ISSUE DATE: 04-20-2016



AN ARCHITECTURAL CORPORATION  
1720 G Street  
Modesto, CA 95354  
209.522.8900  
www.plnarchitects.com



CONSULTING ENGINEER

ARCHITECTURAL SYMBOLS LEGEND	
	DETAIL INDICATOR - REFERENCE & DETAIL INDICATOR - SECTION
	DETAIL INDICATOR - ITEM & DETAIL INDICATOR - AREA
	SECTION INDICATOR - PARTIAL BUILDING/WALL
	SECTION INDICATOR - BUILDING
	ELEVATION INDICATOR - EXTERIOR
	ELEVATION INDICATOR - INTERIOR, SINGLE & MULTIPLE VIEW
	MATCH LINE INDICATOR
	ROOM IDENTIFIER WITH ROOM NAME & NUMBER
	REVISION INDICATOR & REVISION CLOUD
	ELEVATION INDICATOR - LEVEL & SPOT
	REFERENCE GRID WITH REFERENCE GRID LINES
	WINDOW OR LOUVER IDENTIFIER
	DEMO KEYNOTE INDICATOR
	KEYNOTE INDICATOR
	FURNITURE, FIXTURE & EQUIPMENT INDICATOR
	DOOR TAG IDENTIFIER
	PLAN NORTH & TRUE NORTH INDICATOR

ABBREVIATIONS					
AC	ASPHALTIC CONCRETE	FOS	FACE OF STUD FLOOR	PVMT	PAVEMENT
ACC	ACCESSIBLE	FLR	FLOOR	PL	PLATE
AGG	AGGREGATE	FIN	FINISH	PLN	PLAN
A/C	AIR CONDITIONER	FLR	FLOOR	PLWD	PLYWOOD
AL	ALUMINUM	FD	FLOOR DRAIN		
AB	ANCHOR BOLT	FTG	FOOTING	RAD	RADIUS
@	AT	FND	FOUNDATION	RD	ROOF DRAIN
ABV	ABOVE			RM	ROOM
AFF	ABOVE FINISH FLOOR	GA	GALVE	RR	RESTROOM
		GALV	GALVANIZED		
BLK	BLOCK	GL	GLASS OR GLAZING	SCH	SCHEDULE
BLKG	BLOCKING BOARD	GYP BD	GYPSUM BOARD	SHT	SHEET
		HDR	HEADER	SM	SIMILAR
CB	CATCH BASIN	HVAC	HEATING/VENTILATION/AIR CONDITIONING	SPEC	SPECIFICATION
CFCI	CONTRACTOR FURNISHED & INSTALLED	HT	HEIGHT	SG	SQUARE
CG	CORNER GUARD	HORIZ	HORIZONTAL	STD	STANDARD
CLG	CEILING	HB	HOSE BIB	STOR	STORAGE
COL	COLUMN	INT	INTERIOR	SAT	SUSPENDED
CONC	CONCRETE	INT	INTERIOR	SYS	SYSTEM
CMU	CONCRETE MASONRY UNIT	JT	JOINT	TEL	TELEPHONE
CONT	CONTINUOUS OR CONTINUE	LB	LAG BOLT	THK	THICK
		LAV	LAVATORY	TAG	TONGUE & GROOVE
		LT	LIGHT	T.O.P.	TOP OF PLATE (ELEV.)
DIAG	DIAGONAL	LT	LIGHT	TYP	TYPICAL
DS	DOWN SPOUT	MAX	MAXIMUM	UON	UNLESS OTHERWISE NOTED
DWGS	DRAWINGS	MECH	MECHANICAL		
*	DIAMETER	MTL	METAL	VCT	VINYL COMPOSITIONAL TILE
ELECT	ELECTRICAL	MIN	MINIMUM	VB	VINYL BASE
ELEV	ELEVATION	NIC	NOT IN CONTRACT	V.I.F.	VARY IN FIELD
EQ	EQUAL	NTS	NOT TO SCALE	WC	WATER CLOSET
(E)	EXISTING	OBS	OBSOLETE	WP	WEATHER OR WATER PROOF
EXH	EXHAUST	OC	ON CENTER	WD	WOOD
EXT	EXTERIOR	OFCI	OWNER FURNISHED CONTRACTOR INSTALLED		
		OFOI	OWNER FURNISHED OWNER INSTALLED OPERATION ROOM OVER HEAD		
		OR	OVER		
		OH	OVER HEAD		

VICINITY MAP	
PROJECT SCOPE	
TO INSTALL NEW PLYMOVENT EXHAUST REMOVAL APPARATUS SYSTEM IN EXISTING BAYS.	
DEFERRED APPROVALS	
- NONE	
PROJECT DATA	
SITE ADDRESS:	TURLOCK FIRE STATION NO. 3 501 E. MONTE VISTA AVE. TURLOCK, CA 95380
PROJECT AREA:	2300 SQ.FT.
CONSTRUCTION:	V-N
OCCUPANCY TYPE:	R-2
SPRINKLERED:	YES
NUMBER OF FLOORS:	1


PROJECT DIRECTORY	
<b>ARCHITECT</b>	
PIRES, LIPOMI AND NAVARRO ARCHITECTS	
PRINCIPAL ARCHITECT:	GREG PIRES
	1720 G STREET MODESTO, CA 95354 P: 209.522.8900 GREG@PLNARCHITECTS.COM
<b>OWNER</b>	
CITY OF TURLOCK FIRE STATION #3	
PRINCIPAL CIVIL ENGINEER:	NATHAN BRAY, PE
	158 S. BROADWAY, STE 150 TURLOCK, CA 95380 P: 209.668.5599 x4435
<b>SPECIALTY EQUIPMENT</b>	
<b>AIR EXCHANGE</b>	
SPECIALTY EQUIPMENT:	DICK BERTANI
	485 EDISON COURT, STE A FAIRFIELD, CA 94534 P: 800.300.2945 F: 707.864.2705 DICK@AIREXCHANGE.COM

SHEET INDEX		
<b>GENERAL SHEETS</b>		
G0.0 COVER SHEET		
<b>ARCHITECTURAL SHEETS</b>		
A1.1 FLOOR PLAN & DETAILS		
<b>AUTHORITY HAVING JURISDICTION</b>		
SUBMITTAL #		
<p><b>CITY OF TURLOCK FIRE STATION PLYMOVENT EQUIPMENT INSTALL</b></p> <p>501 E. MONTE VITA AVE, TURLOCK, CA 95380</p> <p>CITY OF TURLOCK FIRE DEPARTMENT (Enter Client Address)</p>		
<b>PROJECT DETAILS</b>		
PLN PROJECT NO:	16026.3	
SUBMITTAL DATE:		
<b>PROJECT REVISIONS</b>		
△ MARK	DATE	DESCRIPTION
<b>SHEET DETAILS</b>		
DRAWN BY:	Author	
CHECKED BY:	Checker	
COPYRIGHT:	© PLN ARCHITECTS 2015	
<b>SHEET TITLE</b>		
COVER SHEET		
<b>SHEET NUMBER</b>		
G0.0		


GENERAL NOTES	
1. CODES: ALL WORK SHALL CONFORM TO THE FOLLOWING CODES. CONTRACTOR AND THEIR SUBCONTRACTORS SHALL HAVE WORKING KNOWLEDGE OF ALL CODES, REGULATIONS AND/OR STANDARDS APPLICABLE TO THEIR WORK. CONTRACTOR SHALL MAKE AVAILABLE LISTED CODES AT JOB SITE AT ALL TIMES.	5. ANCHORS: WHEN INSTALLING DRILLED-IN ANCHORS AND/OR POWDER DRIVEN PINS IN EXISTING NON-STRESSED REINFORCED CONCRETE, USE CARE AND CAUTION TO AVOID CUTTING OR DAMAGING THE EXISTING REINFORCING BARS. WHEN INSTALLING THEM INTO EXISTING PRE-STRESSED TENDONS, USE A NONDESTRUCTIVE METHOD PRIOR TO INSTALLATION. EXERCISE EXTREME CARE AND CAUTION TO AVOID CUTTING OR DAMAGING THE TENDONS.
2013 BUILDING ENERGY EFFICIENCY STANDARDS	
2013 CALIFORNIA GREEN BUILDING STANDARDS	
2013 CALIFORNIA ADMINISTRATIVE CODE (CAC) PART 1, TITLE 24, CALIFORNIA CODE OF REGULATIONS (CCR)	6. PLANS: GENERAL CONTRACTOR SHALL MAKE AVAILABLE COMPLETE SETS OF APPROVED CONSTRUCTION DOCUMENTS TO HIS OR HER SUBCONTRACTORS FOR REVIEW. EACH SUBCONTRACTOR SHALL BE RESPONSIBLE FOR REVIEWING THE COMPLETE SET AND COORDINATING ITEMS WHICH PERTAIN TO HIS OR HER WORK WITH OTHER TRADES PRIOR TO COMMENCING WITH THE WORK. MAKE SURE THE DRAWINGS YOU USE ARE APPROVED AND UP TO DATE.
2013 CALIFORNIA BUILDING CODE (CBC) PART 2, TITLE 24, CCR BASED ON THE 2012 INTERNATIONAL BUILDING CODE (IBC)	7. ACCESS: ALL VALVES, DETECTORS, FIRE AND SMOKE DAMPERS SHALL BE ACCESSIBLE, WHETHER OR NOT SHOWN ON PLANS AT EACH LOCATION.
2013 CALIFORNIA ELECTRICAL CODE (CEC) PART 3, TITLE 24, CCR BASED ON THE 2011 NATIONAL ELECTRICAL CODE (NEC)	8. SCOPE OF WORK: IT IS NOT INTENDED THAT THE CONTRACT DOCUMENTS INCLUDE EACH AND EVERY SUBSYSTEM AND SUBCOMPONENT NECESSARY TO FULLY AND PROPERLY COMPLETE THE WORK. SUBSYSTEMS, SUBCOMPONENTS OR DETAILS REQUIRED OR NORMALLY INCLUDED AS TRADE PRACTICE MAY NOT BE SPECIFICALLY MENTIONED OR SHOWN. NEVERTHELESS, CONTRACTOR SHALL BE RESPONSIBLE FOR EACH ELEMENT OF THE WORK.
2013 CALIFORNIA MECHANICAL CODE (CMC) PART 4, TITLE 24, CCR BASED ON THE 2011 UNIFORM MECHANICAL CODE (UMC)	9. FIRE EXTINGUISHERS: NECESSARY 2A-10BC OR BETTER PORTABLE FIRE EXTINGUISHERS ARE PER SECTION 906, PART 9 (CFC), TITLE 24, CAC AND TITLE 19, CCR. AT REMODELS, PROTECT AND PROVIDE ADEQUATE CLEARANCES AROUND EXISTING EXTINGUISHERS CONSTRUCTION AS NECESSARY. ADDITIONAL FIRE EXTINGUISHERS, BY CONTRACTOR, MAY BE NEEDED CONSTRUCTION. PERMANENT FACILITIES REQUIRE A MINIMUM OF ONE PORTABLE FIRE EXTINGUISHER IN APPLICABLE BUILDINGS. LIMIT TRAVEL DISTANCE TO 75 FEET. VERIFY LOCATION(S) WITH OWNER & ALSO IF NOT ALREADY SHOWN ON PLANS. EXTINGUISHERS ARE REQUIRED IN ELEVATOR EQUIPMENT ROOMS. ACCESSIBLE PORTIONS SHALL NOT EXCEED 48" AFF. 20BC OR BETTER
2013 CALIFORNIA PLUMBING CODE (CPC) PART 5, TITLE 24, CCR BASED ON THE 2011 UNIFORM PLUMBING CODE (UPC)	10. SPECIAL TESTING AND INSPECTION FOR EXPANSION ANCHORS, CONCRETE CEILING WIRES ETC. TO BE COORDINATED BY CONTRACTOR. TESTING LAB CONTRACTED BY OWNER. COST OF REINSPECTION TO BE PAID BY CONTRACTOR.
2013 CALIFORNIA FIRE CODE (CFC) PART 9, TITLE 24, CCR BASED ON THE 2011 INTERNATIONAL FIRE CODE (IFC)	
2. EXISTING CONDITIONS: ALL EXISTING CONDITIONS NOT SHOWN OR INDICATED ON THESE PLANS ARE TO REMAIN UNCHANGED. FIELD VERIFY EXISTING CONDITIONS AND ALL DIMENSIONS. ANY DISCREPANCY BETWEEN DRAWINGS AND ACTUAL WORK SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT FOR CORRECTION PRIOR TO COMMENCING WITH THE WORK.	
3. INSULATION: ALL INSULATION MATERIALS, INCLUDING FACINGS, SUCH AS VAPOR BARRIERS OR BREATHER PAPERS INSTALLED WITHIN FLOOR-CEILING ASSEMBLIES, ROOF-CEILING ASSEMBLIES, WALLS, CRAWL SPACES OR ATTICS, SHALL HAVE A FLAME SPREAD RATING NOT TO EXCEED 25 AND A SMOKE DENSITY NOT TO EXCEED 450 WHEN TESTED IN ACCORDANCE WITH SECTION 903 IN THE 2013 CBC.	
4. WORK: ALL WORK SHALL BE DONE IN A NEAT AND WORKMAN LIKE MANNER ACCORDING TO THE BEST TRADE PRACTICE BY THOSE SKILLED IN THE PARTICULAR TRADE. EQUIPMENT, FIXTURES, PIPING, ETC. SHALL BE PLUMB, LEVEL, SQUARE OR CENTERED ETC. EQUIPMENT TO BE INSTALLED IN STRICT COMPLIANCE WITH MANUFACTURERS' RECOMMENDATIONS.	

SITE PLAN	


P:\2016\16026 City of Turlock Fire Station Plymovent Equip. Install\16026.3 Station 3\Modell\16026.3 Turlock Fire Station 3.rvt 9/30/2016 10:33:57 AM

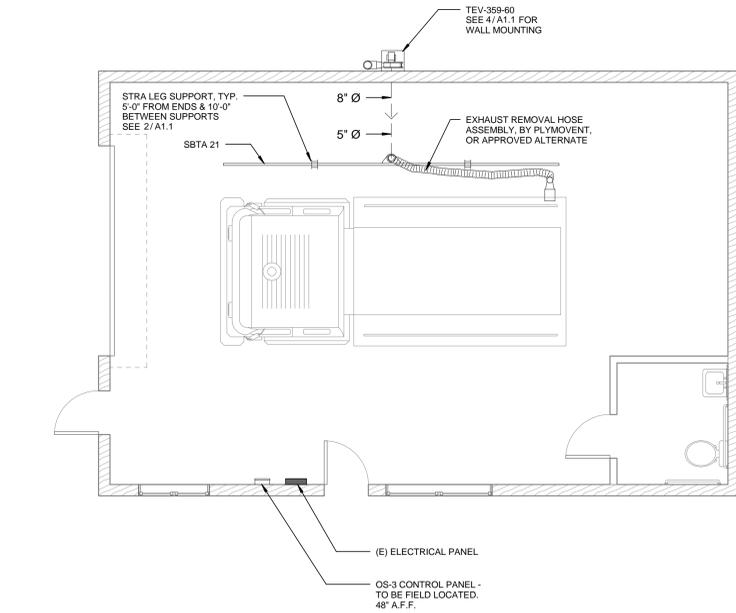


**1 PARTIAL FLOOR PLAN**  
1/4" = 1'-0"

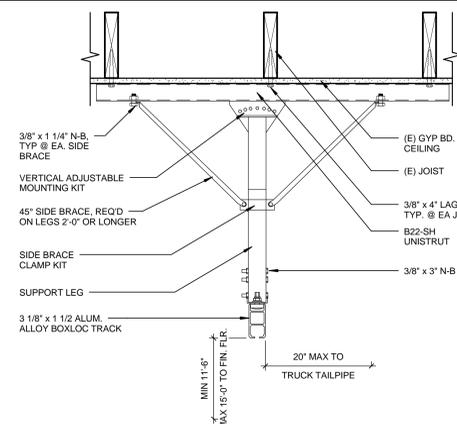

**2 TRACK MOUNTING - FRONT VIEW**  
1 1/2" = 1'-0"

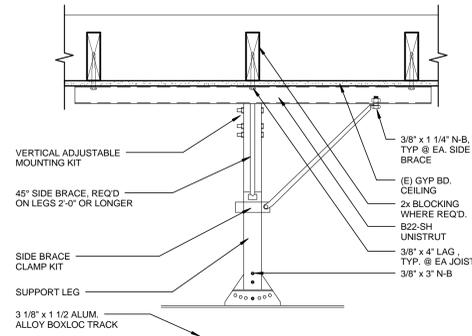

**3 TRACK MOUNTING - SIDE VIEW**  
1 1/2" = 1'-0"

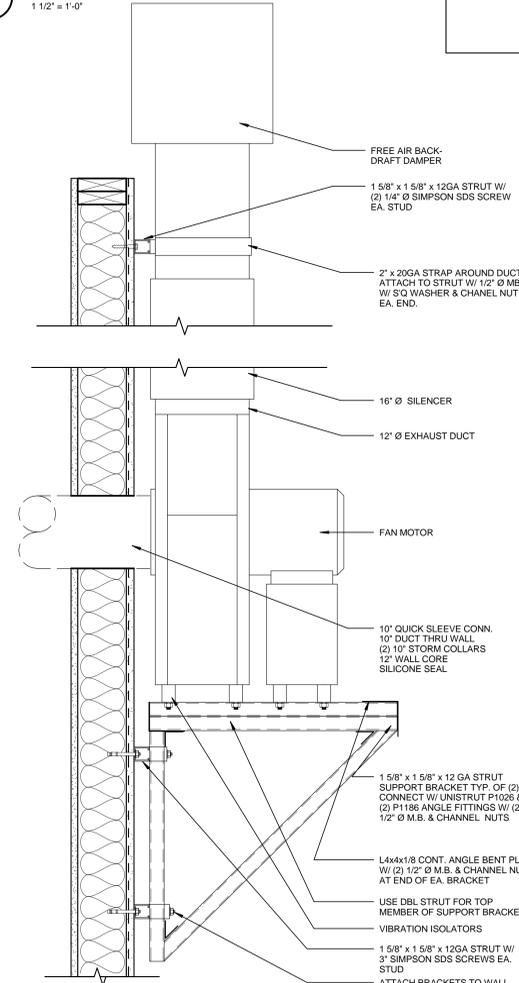

**4 WALL MOUNT FAN**  
1 1/2" = 1'-0"

**WALL LEGEND**

- (E) 2x6 WOOD STUD WALL
- (E) 2x4 WOOD STUD WALL

**ELECTRICAL GENERAL NOTES**

PROVIDE NEW 20 AMP, 2 POLE CIRCUIT BREAKER THAT MATCHES EXISTING ELECTRICAL PANEL SCCR RATING AT EXISTING ELECTRICAL PANEL. UPDATE PANEL SCHEDULE WITHIN EXISTING ELECTRICAL PANEL WITH NEW CIRCUIT. ROUTE NEW 3/4" EMT CONDUIT WITH 2#12 AWG. THHN CU AND 1#12 AWG. CU GND FROM EXISTING ELECTRICAL PANEL TO NEW EXHAUST FAN CONTROL PANEL. ROUTE NEW 3/4" EMT CONDUIT WITH 2#12 AWG. THHN CU AND 1#12 AWG. CU GND FROM NEW EXHAUST FAN CONTROL PANEL TO NEW EXHAUST FAN MOTOR RATED DISCONNECT. PROVIDE NEW 30 AMP MOTOR RATED DISCONNECT AT NEW EXHAUST FAN. PROVIDE FLEX CONNECTION FROM NEW MOTOR RATED DISCONNECT SWITCH TO NEW EXHAUST FAN MOTOR. ROUTE 1/2" EMT CONDUIT FROM NEW EXHAUST FAN CONTROL PANEL TO BAR JOIST TO ENCASE LOW VOLTAGE WIRING 2#16 THHN TO PRESSURE SENSORS. TYPICAL OF ALL PRESSURE SWITCHES, CONTRACTOR SHALL VERIFY QUANTITY OF PRESSURE SENSORS PRIOR TO BID. ELECTRICAL CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO BID. ELECTRICAL CONTRACTOR SHALL VERIFY EXACT LOCATION AND REQUIREMENTS WITH EXHAUST FAN MANUFACTURER AND CITY OF TURLOCK PRIOR TO ROUGH-IN FOR A COMPLETE AND OPERABLE SYSTEM.



**CITY OF TURLOCK FIRE STATION PLYMOVENT EQUIPMENT INSTALL**  
2820 N. WALNUT RD., TURLOCK, CA 95380  
CITY OF TURLOCK FIRE DEPARTMENT  
(Enter Client Address)

**PROJECT DETAILS**

PLN PROJECT NO: 16026.4  
SUBMITTAL DATE:

**PROJECT REVISIONS**

△ MARK	DATE	DESCRIPTION

**SHEET DETAILS**

DRAWN BY: Author  
CHECKED BY: Checker  
COPYRIGHT: © PLN ARCHITECTS 2015

**SHEET TITLE**

FLOOR PLAN & DETAILS

**SHEET NUMBER**


**A1.1**

# CITY OF TURLOCK FIRE STATION PLYMOVENT EQUIPMENT INSTALL

## CITY OF TURLOCK FIRE DEPARTMENT FIRE STATION NO. 4 2820 N. WALNUT RD, TURLOCK, CA 95380

PROJECT STATUS: CONSTRUCTION DOCUMENTS

ISSUE DATE: 04-20-2016



AN ARCHITECTURAL CORPORATION  
1720 G Street  
Modesto, CA 95354  
209.522.8900  
www.plnarchitects.com



CONSULTING ENGINEER

ARCHITECTURAL SYMBOLS LEGEND	ABBREVIATIONS	VICINITY MAP	PROJECT DIRECTORY	SHEET INDEX																																	
<p><b>DETAIL INDICATOR - REFERENCE &amp; DETAIL INDICATOR - SECTION</b></p> <p><b>DETAIL INDICATOR - ITEM &amp; DETAIL INDICATOR - AREA</b></p> <p><b>SECTION INDICATOR - PARTIAL BUILDING WALL</b></p> <p><b>SECTION INDICATOR - BUILDING</b></p> <p><b>ELEVATION INDICATOR - EXTERIOR</b></p> <p><b>ELEVATION INDICATOR - INTERIOR, SINGLE &amp; MULTIPLE VIEW</b></p> <p><b>MATCH LINE</b> SEE XX / X-XXX</p> <p><b>ROOM NAME</b> 101</p> <p><b>REVISION INDICATOR &amp; REVISION CLOUD</b></p> <p><b>ELEVATION INDICATOR - LEVEL &amp; SPOT</b></p> <p><b>REFERENCE GRID WITH REFERENCE GRID LINES</b></p> <p><b>WINDOW OR LOUVER IDENTIFIER</b></p> <p><b>DEMO KEYNOTE INDICATOR</b></p> <p><b>KEYNOTE INDICATOR</b></p> <p><b>FURNITURE, FIXTURE &amp; EQUIPMENT INDICATOR</b></p> <p><b>DOOR TAG IDENTIFIER</b></p> <p><b>PLAN NORTH &amp; TRUE NORTH INDICATOR</b></p>	<p><b>AC</b> ASPHALTIC CONCRETE <b>ACC</b> ACCESSIBLE <b>AGG</b> AGGREGATE <b>A/C</b> AIR CONDITIONER <b>AL</b> ALUMINUM <b>AB</b> ANCHOR BOLT <b>@</b> AT <b>ABV</b> ABOVE <b>AFF</b> ABOVE FINISH FLOOR <b>BLK</b> BLOCK <b>BLKG</b> BLOCKING <b>BD</b> BOARD <b>CB</b> CATCH BASIN <b>CF</b> CONTRACTOR <b>CFCI</b> CONCRETE FURNISHED &amp; INSTALLED <b>CG</b> CORNER GUARD <b>CLG</b> CEILING <b>COL</b> COLUMN <b>CONC</b> CONCRETE <b>CMU</b> CONCRETE MASONRY UNIT <b>CONT</b> CONTINUOUS OR CONTINUE <b>DIAG</b> DIAGONAL <b>DS</b> DOWN SPOUT <b>DWGS</b> DRAWINGS <b>*</b> DIAMETER <b>ELECT</b> ELECTRICAL <b>ELEV</b> ELEVATION <b>EQ</b> EQUAL <b>(E)</b> EXISTING <b>EXH</b> EXHAUST <b>EXT</b> EXTERIOR <b>FOS</b> FACE OF STUD FLUR <b>FLR</b> FLOOR <b>FD</b> FLOOR DRAIN <b>FTG</b> FOOTING <b>FND</b> FOUNDATION <b>GA</b> GAUGE <b>GALV</b> GALVANIZED <b>GL</b> GLASS OR GLAZING <b>GYP BD</b> GYPSUM BOARD <b>HDR</b> HEADER <b>HVAC</b> HEATING/VENTILATION/AIR CONDITIONING <b>HT</b> HEIGHT <b>HORIZ</b> HORIZONTAL <b>HB</b> HOSE BIB <b>INT</b> INTERIOR <b>JT</b> JOINT <b>LB</b> LAG BOLT <b>LAV</b> LAVATORY <b>LT</b> LIGHT <b>MAX</b> MAXIMUM <b>MECH</b> MECHANICAL <b>MTL</b> METAL <b>MIN</b> MINIMUM <b>ELECT</b> ELECTRICAL <b>ELEV</b> ELEVATION <b>EQ</b> EQUAL <b>(E)</b> EXISTING <b>EXH</b> EXHAUST <b>EXT</b> EXTERIOR <b>P/MT</b> PAVEMENT <b>PL</b> PLATE <b>PLN</b> PLAN <b>PLWD</b> PLYWOOD <b>RAD</b> RADIUS <b>RD</b> ROOF DRAIN <b>RM</b> ROOM <b>RR</b> RESTROOM <b>SCH</b> SCHEDULE <b>SHT</b> SHEET <b>SM</b> SIMILAR <b>SPEC</b> SPECIFICATION <b>SQ</b> SQUARE <b>STD</b> STANDARD <b>STOR</b> STORAGE <b>SAT</b> SUSPENDED <b>ACOU</b> ACOUSTICAL TILE <b>SYS</b> SYSTEM <b>TEL</b> TELEPHONE <b>THK</b> THICK <b>TAG</b> TONGUE &amp; GROOVE <b>T.O.P.</b> TOP OF PLATE (ELEV.) <b>TYP</b> TYPICAL <b>UN</b> UNLESS OTHERWISE NOTED <b>VCT</b> VINYL COMPOSITIONAL TILE <b>VB</b> VINYL BASE <b>V.I.F.</b> VARY IN FIELD <b>WC</b> WATER CLOSET <b>WP</b> WEATHER OR WATER PROOF <b>WD</b> WOOD <b>OFI</b> OWNER FURNISHED CONTRACTOR INSTALLED <b>OFU</b> OWNER FURNISHED OWNER INSTALLED <b>OR</b> OPERATION ROOM <b>OH</b> OVER HEAD</p> <p><b>DEMO NOTES</b></p> <p>- NONE</p>	<p><b>VICINITY MAP</b></p> <p><b>PROJECT SCOPE</b></p> <p>TO INSTALL NEW PLYMOVENT EXHAUST REMOVAL APPARATUS SYSTEM IN EXISTING BAYS.</p> <p><b>DEFERRED APPROVALS</b></p> <p>- NONE</p>	<p><b>PROJECT DIRECTORY</b></p> <p><b>ARCHITECT</b> PIRES, LIPOMI AND NAVARRO ARCHITECTS PRINCIPAL ARCHITECT: GREG PIRES 1720 G STREET MODESTO, CA 95354 P: 209.522.8900 GREG@PLNARCHITECTS.COM</p> <p><b>OWNER</b> CITY OF TURLOCK FIRE DEPARTMENT #4 PRINCIPAL CIVIL ENGINEER: NATHAN BRAY, PE 156 S. BROADWAY, STE 150 TURLOCK, CA 95380 P: 209.668.5599 44435</p> <p><b>SPECIALTY EQUIPMENT</b> <b>AIR EXCHANGE</b> SPECIALTY EQUIPMENT: DICK BERTANI 495 EDISON COURT, STE A FAIRFIELD, CA 94534 P: 800.300.2945 F: 707.864.2705 DICK@AIREXCHANGE.COM</p> <p><b>PROJECT DATA</b></p> <p>SITE ADDRESS: CITY OF TURLOCK FIRE STATION NO. 4 2820 N. WALNUT RD TURLOCK, CA 95380</p> <p>PROJECT AREA: 864 SQ. FT. CONSTRUCTION: V-N OCCUPANCY TYPE: R-2 SPRINKLERED: NO NUMBER OF FLOORS: 1</p>	<p><b>SHEET INDEX</b></p> <p><b>GENERAL SHEETS</b> G0.0 COVER SHEET</p> <p><b>ARCHITECTURAL SHEETS</b> A1.1 FLOOR PLAN &amp; DETAILS</p> <p><b>AUTHORITY HAVING JURISDICTION</b></p> <p>CITY OF TURLOCK FIRE DEPARTMENT (Enter Client Address)</p> <p><b>PROJECT DETAILS</b> PLN PROJECT NO: 16026.4 SUBMITTAL DATE:</p> <p><b>PROJECT REVISIONS</b></p> <table border="1"> <thead> <tr> <th>MARK</th> <th>DATE</th> <th>DESCRIPTION</th> </tr> </thead> <tbody> <tr><td> </td><td> </td><td> </td></tr> </tbody> </table> <p><b>SHEET DETAILS</b> DRAWN BY: Author CHECKED BY: Checker COPYRIGHT: © PLN ARCHITECTS 2015</p> <p><b>SHEET TITLE</b> COVER SHEET</p> <p><b>SHEET NUMBER</b> G0.0</p>	MARK	DATE	DESCRIPTION																														
MARK	DATE	DESCRIPTION																																			
<p><b>GENERAL NOTES</b></p> <p>1. CODES: ALL WORK SHALL CONFORM TO THE FOLLOWING CODES. CONTRACTOR AND THEIR SUBCONTRACTORS SHALL HAVE WORKING KNOWLEDGE OF ALL CODES, REGULATIONS AND/OR STANDARDS APPLICABLE TO THEIR WORK. CONTRACTOR SHALL MAKE AVAILABLE LISTED CODES AT JOB SITE AT ALL TIMES.</p> <p>2013 BUILDING ENERGY EFFICIENCY STANDARDS 2013 CALIFORNIA GREEN BUILDING STANDARDS 2013 CALIFORNIA ADMINISTRATIVE CODE (CAC) PART 1, TITLE 24, CALIFORNIA CODE OF REGULATIONS (CCR) 2013 CALIFORNIA BUILDING CODE (CBC) PART 2, TITLE 24, CCR BASED ON THE 2012 INTERNATIONAL BUILDING CODE (IBC) 2013 CALIFORNIA ELECTRICAL CODE (CEC) PART 3, TITLE 24, CCR BASED ON THE 2011 NATIONAL ELECTRICAL CODE (NEC) 2013 CALIFORNIA MECHANICAL CODE (CMC) PART 4, TITLE 24, CCR BASED ON THE 2011 UNIFORM MECHANICAL CODE (UMC) 2013 CALIFORNIA PLUMBING CODE (CPC) PART 5, TITLE 24, CCR BASED ON THE 2011 UNIFORM PLUMBING CODE (UPC) 2013 CALIFORNIA FIRE CODE (CFC) PART 9, TITLE 24, CCR BASED ON THE 2011 INTERNATIONAL FIRE CODE (IFC)</p> <p>2. EXISTING CONDITIONS: ALL EXISTING CONDITIONS NOT SHOWN OR INDICATED ON THESE PLANS ARE TO REMAIN UNCHANGED. FIELD VERIFY EXISTING CONDITIONS AND ALL DIMENSIONS. ANY DISCREPANCY BETWEEN DRAWINGS AND ACTUAL WORK SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT FOR CORRECTION PRIOR TO COMMENCING WITH THE WORK.</p> <p>3. INSULATION: ALL INSULATION MATERIALS, INCLUDING FACINGS, SUCH AS VAPOR BARRIERS OR BREATHER PAPERS INSTALLED WITHIN FLOOR-CEILING ASSEMBLIES, ROOF-CEILING ASSEMBLIES, WALLS, CRAWL SPACES OR ATTICS, SHALL HAVE A FLAME SPREAD RATING NOT TO EXCEED 25 AND A SMOKE DENSITY NOT TO EXCEED 450 WHEN TESTED IN ACCORDANCE WITH SECTION 903 IN THE 2013 CBC.</p> <p>4. WORK: ALL WORK SHALL BE DONE IN A NEAT AND WORKMAN LIKE MANNER ACCORDING TO THE BEST TRADE PRACTICE BY THOSE SKILLED IN THE PARTICULAR TRADE. EQUIPMENT, FIXTURES, PIPING, ETC., SHALL BE PLUMB, LEVEL, SQUARE OR CENTERED ETC., EQUIPMENT TO BE INSTALLED IN STRICT COMPLIANCE WITH MANUFACTURERS' RECOMMENDATIONS.</p> <p>5. ANCHORS: WHEN INSTALLING DRILLED-IN ANCHORS AND/OR POWDER DRIVEN PINS IN EXISTING NON-PRESTRESSED REINFORCED CONCRETE, USE CARE AND CAUTION TO AVOID CUTTING OR DAMAGING THE EXISTING REINFORCING BARS. WHEN INSTALLING THEM INTO EXISTING PRE STRESSED TENDONS, USE A NONDESTRUCTIVE METHOD PRIOR TO INSTALLATION. EXERCISE EXTREME CARE AND CAUTION TO AVOID CUTTING OR DAMAGING THE TENDONS.</p> <p>6. PLANS: GENERAL CONTRACTOR SHALL MAKE AVAILABLE COMPLETE SETS OF APPROVED CONSTRUCTION DOCUMENTS TO HIS OR HER SUBCONTRACTORS FOR REVIEW. EACH SUBCONTRACTOR SHALL BE RESPONSIBLE FOR REVIEWING THE COMPLETE SET AND COORDINATING ITEMS WHICH PERTAIN TO HIS OR HER WORK WITH OTHER TRADES PRIOR TO COMMENCING WITH THE WORK. MAKE SURE THE DRAWINGS YOU USE ARE APPROVED AND UP TO DATE.</p> <p>7. ACCESS: ALL VALVES, DETECTORS, FIRE AND SMOKE DAMPERS SHALL BE ACCESSIBLE, WHETHER OR NOT SHOWN ON PLANS AT EACH LOCATION.</p> <p>8. SCOPE OF WORK: IT IS NOT INTENDED THAT THE CONTRACT DOCUMENTS INCLUDE EACH AND EVERY SUBSYSTEM AND SUBCOMPONENT NECESSARY TO FULLY AND PROPERLY COMPLETE THE WORK. SUBSYSTEMS, SUBCOMPONENTS OR DETAILS REQUIRED OR NORMALLY INCLUDED AS TRADE PRACTICE MAY NOT BE SPECIFICALLY MENTIONED OR SHOWN. NEVERTHELESS, CONTRACTOR SHALL BE RESPONSIBLE FOR EACH ELEMENT OF THE WORK.</p> <p>9. FIRE EXTINGUISHERS: NECESSARY 2A:10BC OR BETTER PORTABLE FIRE EXTINGUISHERS ARE PER SECTION 906, PART 9 (CFC), TITLE 24, CAC AND TITLE 19, CCR. AT REMODELS, PROTECT AND PROVIDE ADEQUATE CLEARANCES AROUND EXISTING EXTINGUISHERS CONSTRUCTION AS NECESSARY. ADDITIONAL FIRE EXTINGUISHERS, BY CONTRACTOR, MAY BE NEEDED CONSTRUCTION. PERMANENT FACILITIES REQUIRE A MINIMUM OF ONE PORTABLE FIRE EXTINGUISHER IN APPLICABLE BUILDINGS. LIMIT TRAVEL DISTANCE TO 75 FEET. VERIFY LOCATIONS) WITH OWNER &amp; ALSO IF NOT ALREADY SHOWN ON PLANS. EXTINGUISHERS ARE REQUIRED IN ELEVATOR EQUIPMENT ROOMS. ACCESSIBLE PORTIONS SHALL NOT EXCEED 48" AFF. 20BC OR BETTER</p> <p>10. SPECIAL TESTING AND INSPECTION FOR EXPANSION ANCHORS, CONCRETE CEILING WIRES ETC. TO BE COORDINATED BY CONTRACTOR. TESTING LAB CONTRACT BY OWNER. COST OF REINSPECTION TO BE PAID BY CONTRACTOR.</p>			<p><b>SITE PLAN</b></p>																																		

**CITY OF TURLOCK FIRE STATION PLYMOVENT EQUIPMENT INSTALL**  
 2820 N. WALNUT RD, TURLOCK, CA 95380  
 CITY OF TURLOCK FIRE DEPARTMENT  
 (Enter Client Address)